
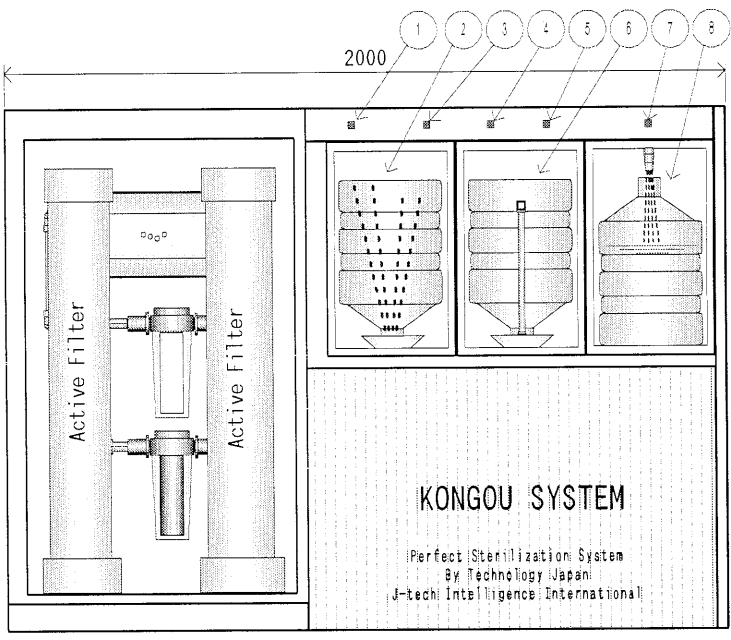


A B C D E F


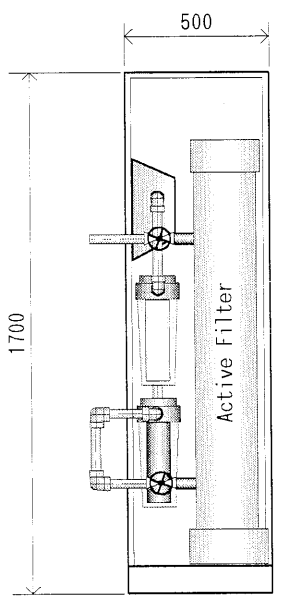


No.	Discription
1	Main Power SW
2	Wash Box
3	Water Discharge SW
4	Shiden Motor Drive UP SW
5	Shiden Motor Drive Down SW
6	BotoI Sterilization BOX
7	Water Fill SW
8	Water Fill BOX (Bakteria Free BOX)

Process Capacity : 400L/h
Power Supply : AC220V 450W(Max)

FUJJIN Unit installed at
BotoI Sterilization BOX and Water Fill
BOX for Bakteria Free Space.

Pwefect Sterilization System KONGOU.

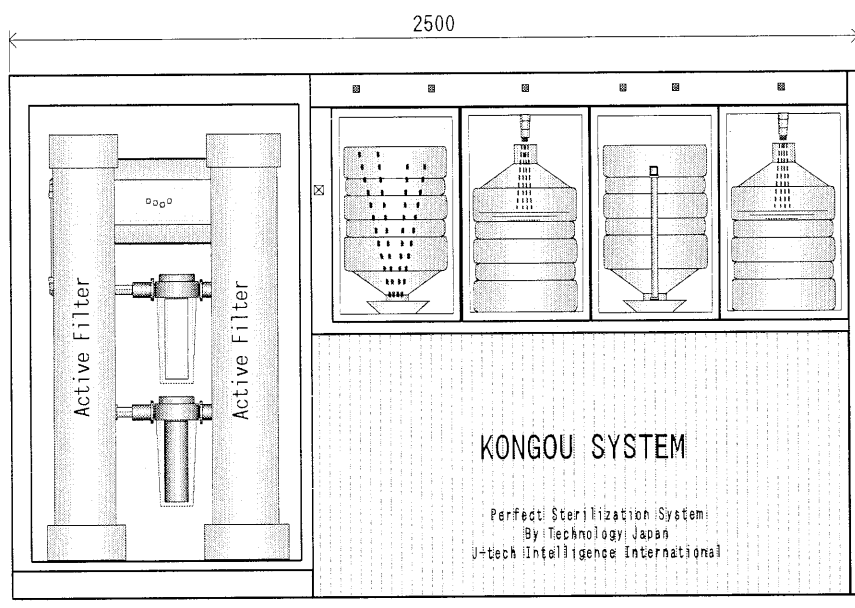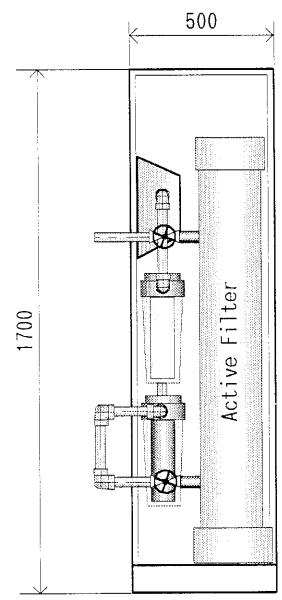

Revision	Date	Drawn	Checked	Chief	Date	Name	 CV J-tech Intelligence International	Title	KONGOU SYSTEM	Control No.	J-KP-002
		Drawn			26-Jan-03	Hisayasu			KONGOU Front Panel	Drawing No.	JFPA3005
		Checked			26-Jan-03	Hisayasu			Model-1,2		
		Chief			28-Jan-03	Hisayasu					

A B C D E F