

LIGHT FIXTURE SCHEDULE

MARK		VOLT	LAMPS	DESCRIPTION
A		120	(2) 32W T8	LITHONIA, 26T-292-AH120 FLUORESCENT, 2X4 RECESSED TROFFER, W/ ACRYLIC LENS.
AE		120	(2) 32W T8	LITHONIA, 26T-292-AH120DEL14 W/ EMERGENCY BATTERY PACK (NOMINAL 1400 LUMENS)
B		120	(2) 32W T8	LITHONIA, 6T8-292-AH120 6EB-10RS
C		120	INTEGRAL	LITHONIA, CUC 1478PH 120LP 5I. CLOSET LIGHT.
D		120	26DTT	LITHONIA, ARV-260TT-6AR-120 6" RECESSED FLUORESCENT DOWNLIGHT. CLEAR ALZACK REFLECTOR.
E		120	70XMP10/UMED	LITHONIA, RECESSED TO HATT METAL HALIDE DOWN LIGHT, MODEL LP6H 10X 1AR 120
F		120	(1) 25W T8	LITHONIA, 2UG-25-120V-5HR 36" UNDERCOUNTER FLUORESCENT.
G		120	75W	PORCELIN BASE A19 FIXTURE FOR AHJ MAINTENANCE. 75W BULB MAXIMUM, PROVIDE WITH GAGE GUARD.
H		120	(1) 150W MH	EXTERIOR METAL HALIDE WALL MOUNTED FIXTURE AS SPECIFIED BY OWNER. MAX 150W LAMP.
J		120	(1) 50W MH	METAL HALIDE UP LIGHT. LUMARK MH-TF-6L-50W-120-LL
K		120	(1) 100W MH	LITHONIA, THRS100MTB1P1 HALL MOUNTED FULL CUT OFF METAL HALIDE FIXTURE
X		120	INTEGRAL	DUAL-LITE # LXURHE WALL MOUNTED EXIT LIGHT. 120V W/ BATTERY BACK UP.
EX		120	INTEGRAL	DUAL-LITE # CVT SERIES COMBINATION WALL MOUNTED EXIT/EMERGENCY LIGHT W/ BATTERY BACK UP, 120V.
EM		120	INTEGRAL	DUAL-LITE # LZ25N-12 WALL MOUNTED EMERGENCY LIGHT WITH 40 MIN. BATTERY BACKUP.

NOTES BY SYMBOL


- TYPE 'X' EXIT LIGHTS, TYPE 'EM' EMERGENCY LIGHTS AND TYPE 'AE' EMERGENCY LIGHTS ARE TO BE PROVIDED WITH EMERGENCY 90 MIN. BATTERY PACKS CIRCUITED TO UNSWITCHED LEG OF LOCAL LIGHT CIRCUIT.
- TYPE 'AENL' AND 'DAL' ARE NIGHT LIGHT FIXTURES AND ARE TO BE UNSWITCHED CIRCUIT WITH EMERGENCY EXIT LIGHTS ON UNSWITCHED LEG OF LOCAL LIGHT CIRCUIT.
- INTERLOCK CEILING MOUNTED EXHAUST FAN WITH LOCAL LIGHT CIRCUIT AND SWITCH. FANS ARE TO BE PROVIDED AND INSTALLED BY THE MECHANICAL CONTRACTOR AND WIRED BY THE ELECTRICAL CONTRACTOR. SEE MECHANICAL EQUIPMENT SCHEDULES FOR ADDITIONAL INFORMATION.
- PROVIDE A BANK OF 120V JP/20 AMP HALL SWITCHES AT 48" AFF FOR MASTER LIGHTING CONTROL. LOWER CASE LETTER INDICATES SWITCH ASSIGNMENT AND CORRESPONDS WITH LETTER AT CIRCUIT DESIGNATION. VERIFY LOCATION.
- CEILING MOUNTED EXHAUST FAN EF4 TO BE CIRCUITED TO UNSWITCHED LEG LOCAL LIGHT CIRCUIT AND CONTROLLED BY HALL MOUNTED TSTAT. FAN AND TSTAT ARE TO BE PROVIDED AND INSTALLED BY THE MECHANICAL CONTRACTOR AND WIRED BY THE ELECTRICAL CONTRACTOR. SEE EXHAUST FAN SCHEDULE FOR ADDITIONAL INFORMATION.
- THIS CIRCUIT IS TO BE SWITCHED AT SWITCH BANK IN RECEPTION AREA. LOWER CASE LETTER INDICATES SWITCH ASSIGNMENT AND CORRESPONDS WITH LETTER AT SWITCH BANK.
- ALL EXTERIOR LIGHT FIXTURES TO BE CIRCUITED ON PANEL#17 HOSE PANEL, AND ARE TO BE CONTROLLED THROUGH TIMELOCK/PHOTOCELL CONTROL. SEE DETAIL ON DRAWING SHEET E3.
- PROVIDE A19 TYPE PORCELIN BASED LIGHT FIXTURE WITH FULL STRINGS IN ATTIC SPACE ABOVE FOR AHJ MAINTENANCE.
- MOUNT PHOTOCELL ON NORTH EAST CORNER OF BUILDING. SEE DETAIL ON DRAWING SHEET E3.
- RE-CIRCUIT EXISTING EMERGENCY FIXTURE TO TENANT'S PANEL DURING TENANT FINISHOUT.



01 LIGHTING PLAN

SCALE: 3/16" = 1'-0"

CONTRACTOR SHALL VERIFY ALL DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECTS OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

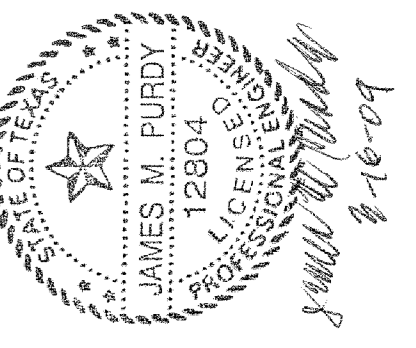

Linear!
 the architecture of Kermery Brundige and Young
 5005 W Royal Lane, Suite 144
 Irving, TX 75063
 Phone: 972.929.9226
 Fax: 972.929.9061
 info@linear-architecture.com

**COOK CHILDREN'S
 PRIMARY CARE CLINIC**
 BURLESON, TX

JOB NUMBER
09.016

SHEET TITLE
**LIGHTING
 PLAN AND
 NOTES**
 SHEET NUMBER

E1

DATE OF ORIGINAL ISSUE
MARCH 16, 2009

REVIEWS

DATE

NO.